

Needle Flame Test Model 4500

Friborg Test Technology AB

Mail address

P.O. Box 63
SE-196 22 Kungsängen
Sweden

Visiting address


Kraftvägen 32
SE-196 37 Kungsängen
Sweden

T: +46 (0) 8 581 610 10
F: +46 (0) 8 505 961 50

info@friborg.se
www.friborg.se

Needle Flame Test - parameters

- Needle burner inside diameter 0,5 mm \pm 0,1 mm
- Sample holder
- Stand for gas container (NOTE! Gas container not included)
- Gas pressure reduction unit
- Gas valve for regulate gas flame
- The equipment is placed on the same aluminium platform

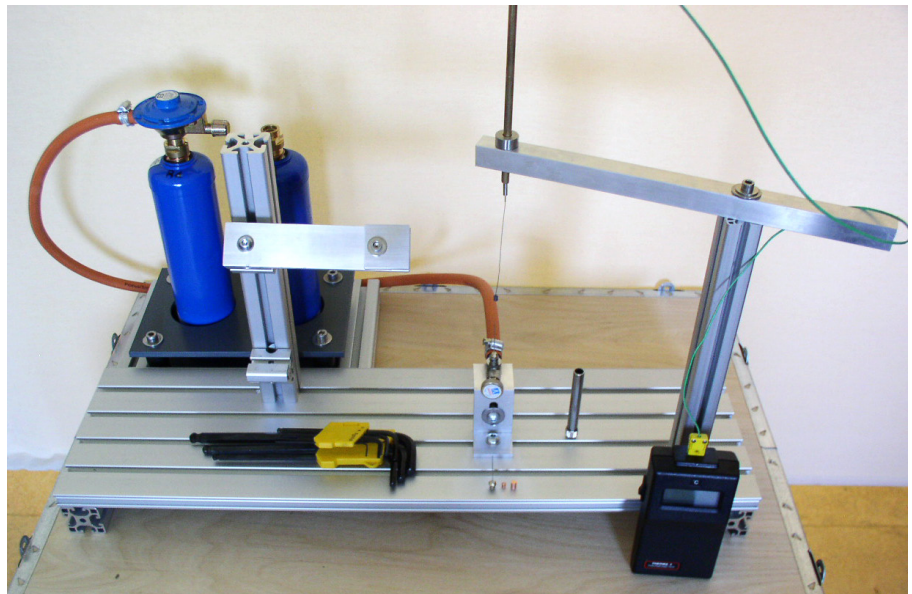

Optional – Cabinet for Needle Flame Tester

- Cabinet 0,5 m³ according to requirement of standard
- 1 pcs transparent doors
- Black painted inside of cabinet for visual inspection of flames
- Fan blow out gases from the cabinet after testing by manual push/pull
- Weight 60 kg
- LxWxH = 1130x780x1000 mm



Facts

IEC:

60695-11-5

Components:

-

Weight:

App 8 kg

Dimensions:

App 700x400x500 mm
(LxWxH) without cabinet

Supply

Gas Butan or Propan. NB!
Due to Safety we send
empty gas containers.